

Job Reference in Thailand #1



Location:	Samutprakarn
Owner:	Central Paper
Industry	
Year:	1996
Fuel Source:	Natural Gas
Gas Turbine:	Solar Taurus 60
Gas Compressor:	EGU 90-TW
Inlet Pressure:	8 bar
Outlet Pressure:	16 bar
Rate Power:	75 kW

Job Reference in Thailand #2



Charoen Pokphand Group
Asia's leading globally committed conglomerate



Location:	Saraburi
Owner:	Bangkok Produce (CP)
Year:	2002
Fuel Source:	Natural Gas
Gas Turbine:	Solar Taurus 60
Gas Compressor:	EGS-T-35/112 W
Inlet Pressure:	3 bar
Outlet Pressure:	17 bar
Rate Power:	112 kW


Job Reference in Thailand #3

AJINOMOTO®



Location:	Samutprakan
Owner:	Ajinomoto
Year:	2006
Fuel Source:	Natural Gas
Gas Turbine:	Solar T130
Gas Compressor:	EGSI-70/400 W
Inlet Pressure:	10 bar
Outlet Pressure:	26bar
Rate Power:	400 kW

Job Reference in Thailand #4

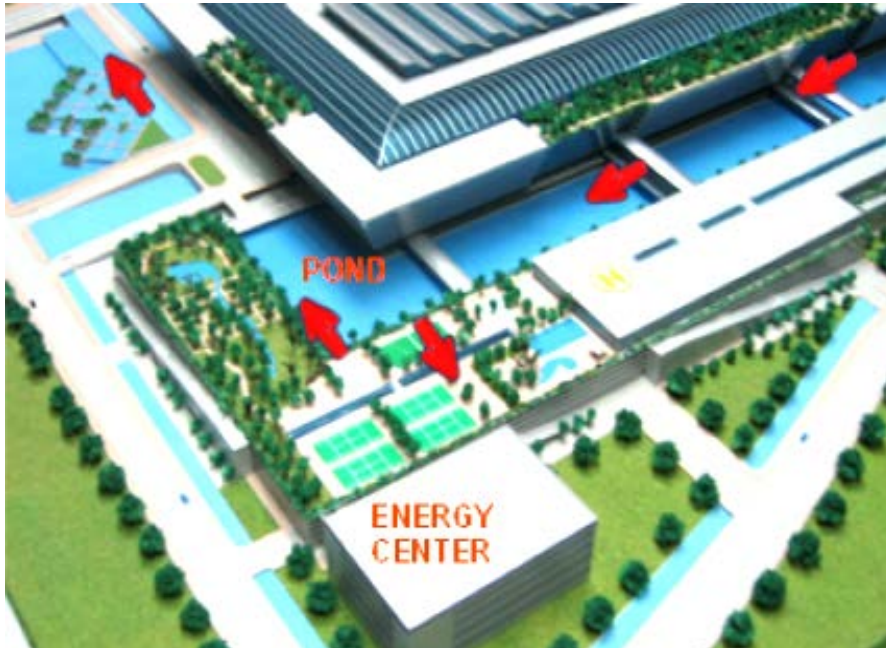

Location:	ChaengWatthana
Owner:	Government Center
Year:	2007
Fuel Source:	Natural Gas
Gas Turbine:	Solar T65
Gas Compressor:	EGS-S-50/250
Inlet Pressure:	4 bar
Outlet Pressure:	18 bar
Rate Power:	250 kW

Job Reference in Thailand #5



บริษัท บางจากปิโตรเลียม จำกัด (มหาชน)
The Bangchak Petroleum Public Company Limited




Location:	Bangkok
Owner:	Bangchak
Year:	2008
Fuel Source:	Natural Gas
Gas Turbine:	Solar Titan130
Gas Compressor:	EGSI-S-70/450W
Inlet Pressure:	8 bar
Outlet Pressure:	35 bar
Rate Power:	450kW

Job Reference in Thailand #6



Location:	Suvarnnabhumi Airport
Owner:	DCAP
Year:	2010
Fuel Source:	Natural Gas
Gas Turbine:	GE LM6000
Gas Compressor:	EGSI-S-80/750W
Inlet Pressure:	15 bar
Outlet Pressure:	46 bar
Rate Power:	750KW

Job Reference in Thailand #7

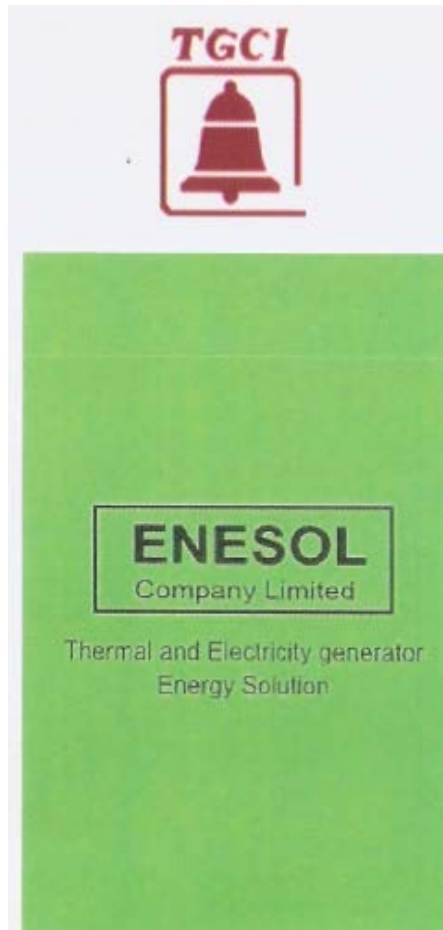

Location:	Nongkhea, Saraburi
Owner:	Thai Geraman Ceramic
Year:	2011
Fuel Source:	Natural Gas
Gas Turbine:	TAURUS 60
Gas Compressor:	EGS-S-20/110 WA
Inlet Pressure:	11.9 bar
Outlet Pressure:	20 bar
Rate Power:	110KW

Job Reference in Thailand #8

Gulf JP
Group of Power Companies



Location: Muang, Saraburi
Owner: Gulf JP Company
Year: 2011
Fuel Source: Natural Gas
Gas Turbine: SIEMENS SGT 800
Gas Compressor: EGSI-S-120/700W
Inlet Pressure: 10.5 bar
Outlet Pressure: 30.5 bar
Rate Power: 700KW

Job Reference in Thailand #9

Gulf JP
Group of Power Companies



Location: Nongkhae, Saraburi
Owner: Gulf JP Company
Year: 2011
Fuel Source: Natural Gas
Gas Turbine: SIEMENS SGT 800
Gas Compressor: EGSI-S-120/200W
Inlet Pressure: 23.5 bar
Outlet Pressure: 30.5 bar
Rate Power: 200KW

Job Reference in Thailand #10

Gulf JP
Group of Power Companies



Location: Nongkhae, Saraburi
Owner: Gulf JP Company
Year: 2011
Fuel Source: Natural Gas
Gas Turbine: SIEMENS SGT 800
Gas Compressor: EGSI-S-60/200W
Inlet Pressure: 23.5 bar
Outlet Pressure: 30.5 bar
Rate Power: 200KW

Job Reference in Thailand #11



Location:	Amata Bangkadi
Owner:	Amata Bangkadi
Year:	2013
Fuel Source:	Natural Gas
Gas Turbine:	GE LM6000
Gas Compressor:	EGSI-S-90/880W
Inlet Pressure:	17 bar
Outlet Pressure:	52.5 bar
Rate Power:	880KW

Job Reference in Thailand #12



Location:	Lat Krabang
Year:	2013
Fuel Source:	Natural Gas
Gas Turbine:	SIEMENT STG 800
Gas Compressor:	EGS-S-150/500 W
Inlet Pressure:	21.2 barg
Outlet Pressure:	30 barg
Rate Power:	500KW

Job Reference in Thailand #13



Location:	Bangpoo
Year:	2013
Fuel Source:	Natural Gas
Gas Turbine:	SIEMENT STG 800
Gas Compressor:	EGS-S- 210/1000 W
Inlet Pressure:	14.3 barg
Outlet Pressure:	30 barg
Rate Power:	1000KW

Job Reference in Vietnam #1



Location:	Lao Gai
Year:	2013
Refrigerant:	Ammonia
Capacity :	2,000 kg/hr
Heat Duty :	642 kW
Motor rated power :	160 kW
Cooling water required :	198 m ³ /hr @34°C
Max. working pressure:	23bar